

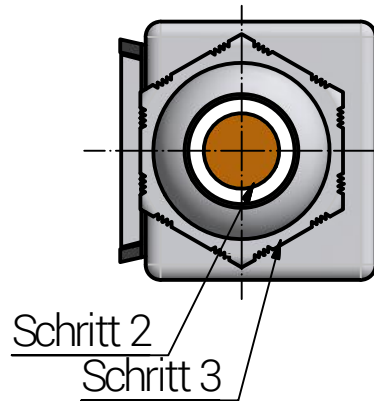
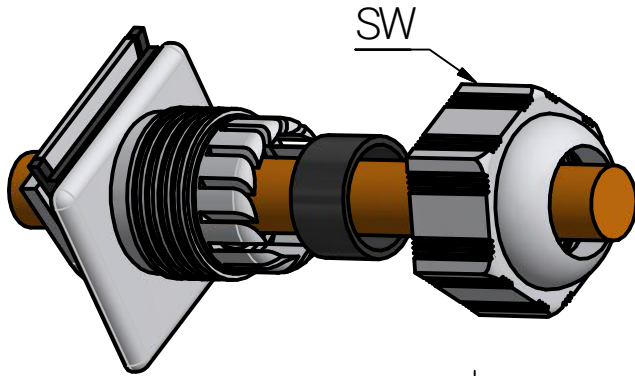


Montageanleitung

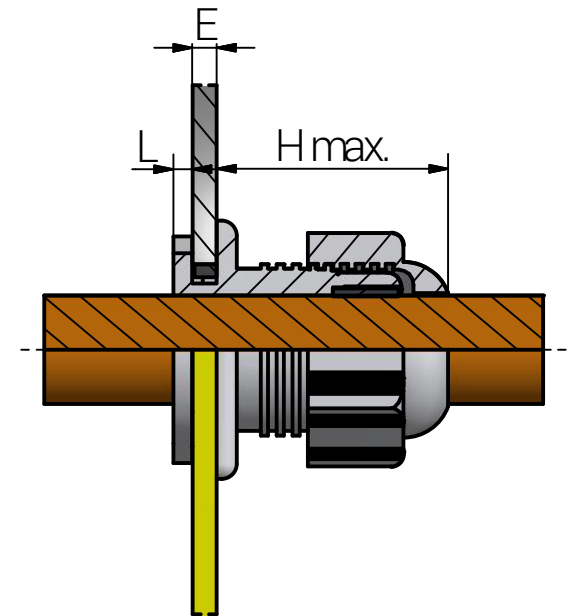

Schritt 1
28,22

Ausschnitt in der Gehäusewand

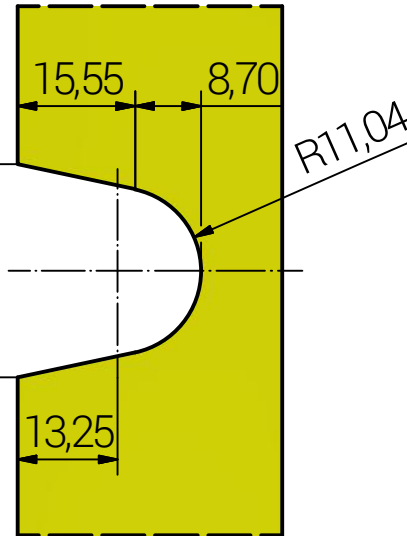

Schritt	Montageschritt (Die Installation sollte nur von einem qualifizierten Elektriker durchgeführt werden, der in der Installation von Kabelverschraubungen geschult ist.)
1	Kabelverschraubung in die bearbeitete Gehäusewand einsetzen.
2	Kabel durch die Kabelverschraubungen führen.
3	Hutmutter soweit anziehen, dass der Dichteinsatz seine Funktion erfüllt. Zu festes Anziehen kann zu Beschädigungen führen.
IP-Schutzart ist IP 65.	
Zugentlastung gemäß EN 62444:2013* - Kategorie A	
Einsatztemperatur: -20°C bis +100°C kurzfristig bis +150°C	
* Von EURO-TOP PA übernommen.	



RST Rabe-System-Technik und Vertriebs-GmbH
Otto-Lilienthal-Strasse 19
49134 Wallenhorst
☎ +49 5407 8766-0
✉ +49 5407 8766-99
info@rst.eu

Artikel	Klemmbereich (mm)		SW (mm)	H max. (mm)	L (mm)	E (mm)	Anzugsdrehmoment (Nm) ADM*	
	≥	≤					Hutmutter	Stutzen
11082400	10,0	14,0	27	30,1	5,7	3,2	5,5	3,5
11182400	7,0	12,0	27	30,1	5,7	3,2	5,5	3,5

Unless otherwise specified on the drawing:
Metric Thread = EN 60423
PG Thread = DIN 40430
NPT Thread = ANSI B1.20.1
Tolerance: DIN ISO 2768-m
All dimensions in mm.



Abusively use, in particular reproduction and dissemination to third parties is not permitted. You can be punished by civil law. Technical changes are reserved.

				Date	Name
			Draw.	02.11.2020	SL
			Appr.	02.11.2020	KH
			Norm		
			Scale:		1:1
			Material:		Polyamid
A	ADM+Zugentl. ergänzt	10.01.2023	SL		
Status	Modification	Date	Name	Z:\Inventor\Montageanleitung\Euro-Top-Einsteck-KV\ET-Einsteck-KV-11x82400_SZ_TD_German.idw	



Euro-Top EINSTECK-KV

Drawing-Nr.: 11x82400_SZ_TD_German	1 of 1
	A4
	V25

Mounting Instruction

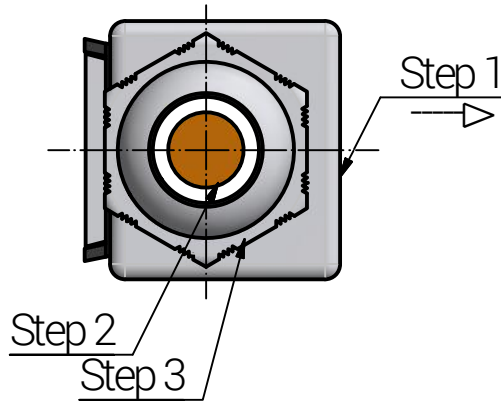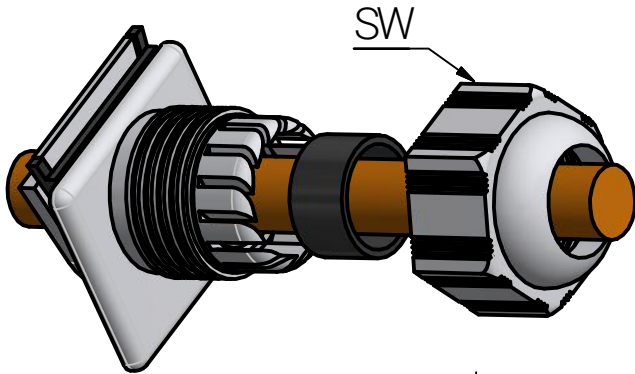

Cutout in the housing wall

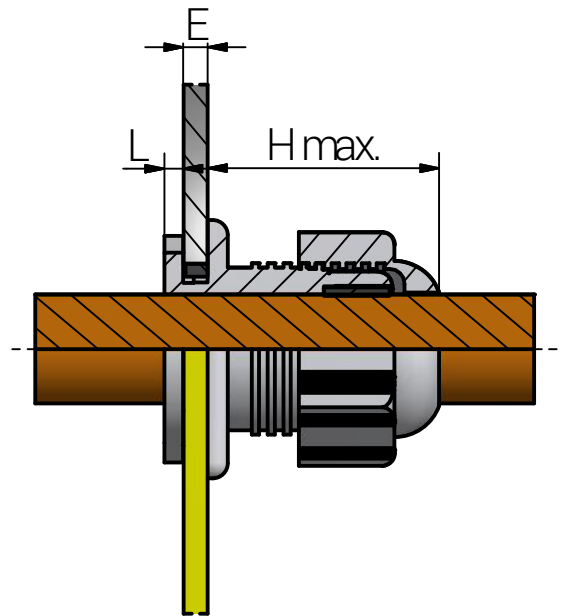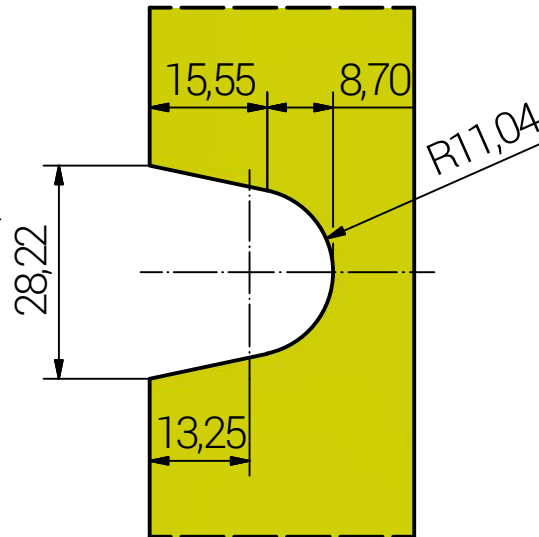

Article	Clamping Range (mm)		SW (mm)	H max. (mm)	L (mm)	E (mm)	Tightening Torque (Nm) TT*	
	≥	≤					Cap	Body
11082400	10,0	14,0	27	30,1	5,7	3,2	5,5	3,5
11182400	7,0	12,0	27	30,1	5,7	3,2	5,5	3,5

Step	Assembly Steps (The installation should only be done by a qualified electrician who are trained in the installation of cable glands.)
1	Insert the cable gland into the machined enclosure wall.
2	Pass the cable through the cable gland.
3	Tighten the cap until the seal fulfills its function. Over tightening may cause damage.
Protection Class: IP 65.	
Type of cable anchorage according to EN62444:2013* - Balance = Category A	
Operating Temperature: -20°C to +100°C intermittent up +150°C	
* Adopted by EURO-TOP PA.	

 connected by competence				RST Rabe-System-Technik und Vertriebs-GmbH Otto-Lilienthal-Strasse 19 49134 Wallenhorst ☎ +49 5407 8766-0 ✉ +49 5407 8766-99 ✉ info@rst.eu				Unless otherwise specified on the drawing: Metric Thread = EN 60423 PG Thread = DIN 40430 NPT Thread = ANSI B1.20.1 Tolerance: DIN ISO 2768-m All dimensions in mm.				Abusively use, in particular reproduction and dissemination to third parties is not permitted. You can be punished by civil law. Technical changes are reserved.			
					Date	Name	Euro-Top Plug In Gland								
				Draw.	02.11.2020	SL									
				Appr.	02.11.2020	KH									
				Norm											
				Scale:		1:1									
				Material:			Drawing-Nr:					1	of		
				Polyamide			11x82400_SZ_TD_English					1	1		
A	TT + Category A	10.01.2023	SL									A4			
Status	Modification	Date	Name	Z:\Inventor\Montageanleitung\Euro-Top-Einsteck-KV\ET-Einsteck-KV-11x82400_SZ_TD_English.idw								V6			